

# 2022 Water Quality Report



City of **LA HABRA**  
Water Division

DATA FOR 2021



# Your 2022 Water Quality Report

Since 1990, California public water utilities have been providing an annual Water Quality Report to their customers. **This year's report covers calendar year 2021 drinking water quality testing and reporting.**

Your City of La Habra Water Division (City) vigilantly safeguards its water supply and, as in years past, the water delivered to your home meets the quality standards required by federal and state regulatory agencies. The U.S. Environmental Protection Agency (USEPA) and the State Water Resources Control Board, Division of Drinking Water (DDW) are the agencies responsible for establishing and enforcing drinking water quality standards.

In some cases, the City goes beyond what is required by testing for unregulated chemicals that may have known health risks but do not have drinking water standards. For example, the California Domestic Water Company (Cal Domestic), which supplies the City with treated groundwater, and the Metropolitan Water District of Southern California (MWDSC), which supplies treated imported surface water to the City, routinely tests for unregulated chemicals in our water supply. Unregulated chemical monitoring helps USEPA and DDW determine where certain chemicals occur and whether new standards need to be established for those chemicals to protect public health.



## We Appreciate All You Do to Save Water

Thank you! For all we've been through these many years of intermittent drought, the City of La Habra Water Division extends its heartfelt thanks to all of you who have worked so hard to conserve water. When the seemingly impossible was asked of you — that you conserve 20% of our water at the height of the last drought — you not only met this goal, you exceeded it. And best of all, you continued to conserve water after the drought was officially declared to be over.



Unfortunately, the first three months of 2022 are the driest months to date in 128 years, and we must again set our sights on conserving even greater amounts of water. Already, Gov. Gavin Newsom has called for all water agencies to prepare plans to implement, at a minimum, Level 2 Water Conservation measures. Among these, irrigation of "non-functional turf," or ornamental turf not used for human recreation, will be banned in commercial, industrial, and institutional settings.

It is our fondest hope we will escape another year of drought. But beyond our hopes, we have confidence the citizens of the City of La Habra will always know what to do to conserve their water.

Through the drinking water quality testing programs carried out by the City and Cal Domestic for our groundwater, MWDSC for imported surface water and the City for our water distribution system, your drinking water is constantly monitored from source to tap for regulated and unregulated constituents.

The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data, though representative, are more than one year old.



This report contains important information about your drinking water.

If you do not understand it, speak with someone who can explain it.



*Este informe contiene información muy importante sobre su agua potable.*

*Para más información ó traducción, favor de contactar a*

*Customer Service Representative.*

*Telefono: (714) 536-5921.*

# Constant Monitoring Ensures Continued Excellence

## Sources of Supply

Your drinking water is a blend of surface water imported by MWDSC, and groundwater imported from Cal Domestic and three wells within the City. Cal Domestic water originates from the Main San Gabriel groundwater basin. MWDSC's imported water sources are the Colorado River and the State Water Project, which draws water from the Sacramento-San Joaquin River Delta. City wells draw water from the La Habra Groundwater Basin.



Englebright Dam on the Yuba River

## Basic Information About Drinking Water Contaminants

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of land or through the layers of the ground it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animal and human activity.



Contaminants that may be present in source water include:

- ◆ **Pesticides and herbicides**, which may come from a variety of sources such as agriculture, urban stormwater runoff and residential uses.
- ◆ **Radioactive contaminants**, which can be naturally occurring or be the result of oil and gas production or mining activities.
- ◆ **Organic chemical contaminants**, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gasoline stations, urban stormwater runoff, agricultural application and septic systems.
- ◆ **Inorganic contaminants**, such as salts and metals, which can be naturally occurring or result from urban storm runoff, industrial or domestic wastewater discharges, oil and gas production, mining and farming.

- ◆ **Microbial contaminants**, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.

In order to ensure that tap water is safe to drink, USEPA and the DDW prescribe regulations that limit the amount of certain contaminants in water provided by public water systems.

The U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk.

More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline at (800) 426-4791, on the web at [www.epa.gov/safewater](http://www.epa.gov/safewater).

## Drinking Water Fluoridation

Fluoride has been added to U.S. drinking water supplies since 1945. Of the 50 largest cities in the U.S., 43 fluoridate their drinking water. In December 2007, the MWDSC joined a majority of the nation's public water suppliers in adding fluoride to drinking water in order to prevent tooth decay. MWDSC was in compliance with all provisions of the State's fluoridation system requirements.



Our local water is not supplemented with fluoride. Fluoride levels in drinking water are limited under California state regulations at a maximum dosage of 2 parts per million.

Additional information about the fluoridation of drinking water is available on these websites:

### State Water Resources Control Board, Division of Drinking Water

[www.waterboards.ca.gov/drinking\\_water/certlic/drinkingwater/Fluoridation.html](http://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/Fluoridation.html)

### U.S. Centers for Disease Control and Prevention

[www.cdc.gov/fluoridation/](http://www.cdc.gov/fluoridation/)

For more information about MWDSC's fluoridation program, please contact Edgar G. Dymally at (213) 217-5709 or at [edydymally@mwdh2o.com](mailto:edydymally@mwdh2o.com).

# We Comply with All State & Federal Water Quality Regulations



## About Lead in Tap Water

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing.


The City is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking.

If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline, (800) 426-4791, or on the web at: [www.epa.gov/safewater/lead](http://www.epa.gov/safewater/lead).

## Immunocompromised People

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised people, such as those with cancer who are undergoing chemotherapy, persons who have had organ transplants, people with HIV/AIDS or other immune system disorders, some elderly persons and infants can be particularly at risk to infection. These people should seek advice about drinking water from their health care providers.

The USEPA and the federal Centers for Disease Control guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from USEPA's Safe Drinking Water Hotline at (800) 426-4791, or on the web at [www.epa.gov/safewater](http://www.epa.gov/safewater).

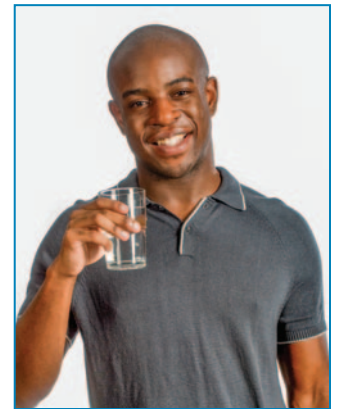

## How to Read Your Residential Water Meter



Your water meter is usually located between the sidewalk and curb under a cement cover. Remove the cover by inserting a screwdriver in the hole in the lid and then carefully lift the cover. The meter reads straight across, like the odometer on your car. The meter shown reads 0006682.71 or, for

billing purposes, 66. The City bills in 100 cubic foot (748 gallons) increments with 100 cubic foot equivalent to 1 billing unit. 100 cubic feet = 748 gallons = 1 billing unit.

**Water Meter Reading** - The number shown indicates all water that has passed through the meter in its lifetime (in cubic feet). To know how much water is used in a given period, subtract the last reading from the

current total (you'll need to take two readings or look at your last billing statement). The difference is the amount of water used.

**Rate of Flow** - A second reading, the "Rate," will be displayed constantly with the Meter Reading. "Rate" is the amount of water (in gallons per minute) passing through the meter at that moment. It can be used for leak detection. If all water is shut off and a rate is observed, this means water is flowing through the meter.

Many of the water system's meters are automated. These meters have the ability to record hourly volumes of water used, and can help determine the presence of a leak when flow is continuous over extended periods of time. If your meter has been exchanged for a new, automated meter, you can view your water use through an on-line customer portal. Please, contact our office at (562)383-4170 for more information.


## Where Do We Use Water the Most?

Outdoor watering of lawns and gardens makes up approximately 60% of home water use. By reducing your outdoor water use — by either cutting back on irrigation or planting more drought tolerant landscaping — you can dramatically reduce your overall water use.

*Save the most where you use the most: Make your outdoor use efficient.*

- Showers & Baths: 8%
- Clothes Washers: 9%
- Dishwashers: 1%
- Toilets: 11%
- Leaks: 7%
- Faucets: 6%

Data is representative of average consumption; your water usage may vary.

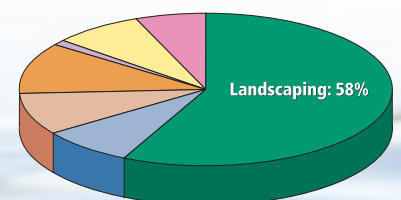

## Water Conservation: A Little Effort Can Save a Lot of Water *and Money*

The La Habra Water Division promotes the conservation of water to its residents so the City can preserve this scarce resource and save residents money in the process.

Water is brought to Southern California via large aqueduct systems that feed off of rivers from the Central Valley and the Colorado River. There are large costs involved in maintaining these systems and transporting the water over miles of deserts, valleys and mountain ranges. The MWDC is the main supplier of this water and controls the vast network of aqueducts, pumping stations and filtration plants.

Local municipal water suppliers do have the ability to tap into underground aquifers, but this local supply of water is not enough to meet the demands of the residents; the more expensive "aqueduct" water must be used to meet the demand. For these reasons, it is recommended that you conserve water by reducing water waste. This will save you money as well.

Simple water saving acts like the ones listed here can save countless gallons of water every day.



Soak pots and pans instead of letting water run while you scrub them clean. ***This both saves water and makes the job easier.***



Keep a pitcher of drinking water in the refrigerator. ***This can save gallons of water every day and it's always cold!***



Plug the sink instead of running water to rinse your razor or wet your toothbrush. ***This can save upwards of 300 gallons of water a month.***



Use a broom instead of a hose to clean off sidewalks and driveways. ***It takes very little time to sweep and the water savings quickly adds up.***



Check your sprinkler system for leaks, overspray, and broken sprinkler heads and repair promptly. ***This can save countless gallons each time you water.***



Water plants in the early morning. ***It reduces evaporation and ensures deeper watering.***

MWDC has its own water conservation website. To find out more information on water saving plants and other useful tips, visit [www.bewaterwise.com](http://www.bewaterwise.com).

## Chart Legend

### What are Water Quality Standards?

Drinking water standards established by USEPA and DDW set limits for substances that may affect consumer health or aesthetic qualities of drinking water. The charts in this report show the following types of water quality standards:

- **Maximum Contaminant Level (MCL):** The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible.
- **Maximum Residual Disinfectant Level (MRDL):** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
- **Secondary MCLs:** Set to protect the odor, taste, and appearance of drinking water.
- **Primary Drinking Water Standard:** MCLs for contaminants that affect health along with their monitoring and reporting requirements and water treatment requirements.
- **Regulatory Action Level (AL):** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

### How are Contaminants Measured?

Water is sampled and tested throughout the year. Contaminants are measured in:

- parts per million (ppm) or milligrams per liter (mg/L)
- parts per billion (ppb) or micrograms per liter (µg/L)
- parts per trillion (ppt) or nanograms per liter (ng/L)

### What is a Water Quality Goal?

In addition to mandatory water quality standards, USEPA and DDW have set voluntary water quality goals for some contaminants. Water quality goals are often set at such low levels that they are not achievable in practice and are not directly measurable. Nevertheless, these goals provide useful guideposts and direction for water management practices. The charts in this report include three types of water quality goals:

- **Maximum Contaminant Level Goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by USEPA.
- **Maximum Residual Disinfectant Level Goal (MRDLG):** The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
- **Public Health Goal (PHG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

## 2021 City of La Habra Drinking Water Quality Local Groundwater and Imported Metropolitan Water District Treated Surface Water

Chemical	MCL	PHG (MCLG)	Average Groundwater Amount	Average MWD Amount	Range of Detections	MCL Violation?	Typical Source of Contaminant
<b>Organic Chemicals – Tested in 2021</b>							
Tetrachloroethylene, PCE (ppb)	5	0.06	<0.5	ND	ND – 0.82	No	Industrial Waste Discharge
Trichloroethylene, TCE (ppb)	5	1.7	<0.5	ND	ND – 1.5	No	Industrial Waste Discharge
<b>Radiologicals – Tested in 2016-2021</b>							
Gross Alpha Particle Activity (pCi/L)	15	(0)	3.4	ND	ND – 7.6	No	Erosion of Natural Deposits
Gross Beta Particle Activity (pCi/L)	50	(0)	NR	5	4 – 6	No	Decay of Natural and Man-made Deposits
Uranium (pCi/L)	20	0.43	3	2	ND – 6.6	No	Erosion of Natural Deposits
<b>Inorganic Chemicals – Tested in 2021</b>							
Aluminum (ppm)	1	0.6	ND	0.141	ND – 0.21	No	Treatment Process Residue, Natural Deposits
Arsenic (ppb)	10	0.004	<2	ND	ND – 2.7	No	Erosion of Natural Deposits
Barium (ppm)	1	2	<0.1	0.111	ND – 0.13	No	Erosion of Natural Deposits
Bromate (ppb)	10	0.1	NR	ND	ND – 4.6	No	Byproduct of Drinking Water Ozonation
Fluoride (ppm) naturally-occurring	2	1	0.35	NR	0.19 – 0.55	No	Erosion of Natural Deposits
Fluoride (ppm) treatment-related	2	1	NR	0.7	0.6 – 0.9	No	Water Additive for Dental Health
Nickel (ppb)	100	12	<10	ND	ND – 12	No	Erosion of Natural Deposits
Nitrate as N (ppm)	10	10	2.2	ND	ND – 4.6	No	Agriculture Runoff and Sewage
Nitrate + Nitrite as N (ppm)	10	10	2.1	ND	ND – 3.4	No	Agriculture Runoff and Sewage
Perchlorate (ppb)	6	1	<2	ND	ND – 4.4	No	Industrial Waste Discharge
<b>Secondary Standards* – Tested in 2021</b>							
Aluminum (ppb)	200*	600	ND	141	ND – 210	No	Treatment Process Residue, Natural Deposits
Chloride (ppm)	500*	n/a	59	96	20 – 120	No	Runoff or Leaching from Natural Deposits
Color (color units)	15*	n/a	1.7	1	ND – 5	No	Runoff or Leaching from Natural Deposits
Iron (ppb)	300*	n/a	90	ND	ND – 540	No	Runoff or Leaching from Natural Deposits; Industrial Wastes
Manganese (ppb)	50*	n/a	17	ND	ND – 37	No	Runoff or Leaching from Natural Deposits
Odor (threshold odor number)	3*	n/a	1	2	1 – 2	No	Naturally-occurring Organic Materials
Specific Conductance (µmho/cm)	1,600*	n/a	850	958	490 – 1,300 "	No	Substances that Form Ions in Water
Sulfate (ppm)	500*	n/a	120	214	42 – 230	No	Runoff or Leaching from Natural Deposits
Total Dissolved Solids (ppm)	1,000*	n/a	530	597	290 – 850	No	Runoff or Leaching from Natural Deposits
Turbidity (NTU)	5*	n/a	1.1	ND	ND – 5.4	No	Runoff or Leaching from Natural Deposits
<b>Unregulated Chemicals – Tested in 2021</b>							
Alkalinity, total as CaCO <sub>3</sub> (ppm)	Not Regulated	n/a	240	125	124 – 330	n/a	Runoff or Leaching from Natural Deposits
Boron (ppm)	NL=1	n/a	0.24	0.13	ND – 0.55	n/a	Runoff or Leaching from Natural Deposits
Calcium (ppm)	Not Regulated	n/a	63	66	55 – 68	n/a	Runoff or Leaching from Natural Deposits
Hardness, total as CaCO <sub>3</sub> (ppm)	Not Regulated	n/a	250	274	220 – 290	n/a	Runoff or Leaching from Natural Deposits
Hardness, total (grains/gal)	Not Regulated	n/a	15	16	13 – 17	n/a	Runoff or Leaching from Natural Deposits
Chromium, Hexavalent (ppb)	Not Regulated	0.02	1.3	ND	ND – 2.6	n/a	Runoff or Leaching from Natural Deposits
Magnesium (ppm)	Not Regulated	n/a	21	25	12 – 34	n/a	Runoff or Leaching from Natural Deposits
pH (pH units)	Not Regulated	n/a	7.9	8.1	7.6 – 8.3	n/a	Hydrogen Ion Concentration
Potassium (ppm)	Not Regulated	n/a	4	4.4	3.4 – 4.7	n/a	Runoff or Leaching from Natural Deposits
Sodium (ppm)	Not Regulated	n/a	70	94	17 – 180	n/a	Runoff or Leaching from Natural Deposits
Total Organic Carbon (ppm)	TT	n/a	NR	2.4	1.9 – 2.8	n/a	Various Natural and Man-made Sources

ppb = parts-per-billion; ppm = parts-per-million; ppt = parts-per-trillion; pCi/L = picoCuries per liter; NTU = nephelometric turbidity units; µmho/cm = micromhos per centimeter; NR = not required to be tested; ND = not detected; < = average is less than the detection limit for reporting purposes; MCL = Maximum Contaminant Level; (MCLG) = federal MCL Goal; PHG = California Public Health Goal; n/a = not applicable; NL = Notification Level; TT = treatment technique

\*Contaminant is regulated by a secondary standard.

Turbidity – combined filter effluent Metropolitan Water District Diemer Filtration Plant	Treatment Technique	Turbidity Measurements	TT Violation?	Typical Source of Contaminant
1) Highest single turbidity measurement (NTU)	0.3	0.03	No	Soil Runoff
2) Percentage of samples less than or equal to 0.3 NTU	95%	100%	No	Soil Runoff

Turbidity is a measure of the cloudiness of the water, an indication of particulate matter, some of which might include harmful microorganisms. Low turbidity in Metropolitan's treated water is a good indicator of effective filtration. Filtration is called a "treatment technique" (TT). A treatment technique is a required process intended to reduce the level of contaminants in drinking water that are difficult and sometimes impossible to measure directly.

### Unregulated Chemicals Requiring Monitoring

Chemical	Notification Level	PHG	Average Groundwater Amount	Average MWD Amount	Range of Detections	Most Recent Sampling Date
Germanium (ppb)	n/a	n/a	0.51	ND	ND – 0.57	2019
Manganese (ppb)	SMCL = 50	n/a	18	ND	ND – 34	2019

SMCL = Secondary MCL

Manganese was included as part of the unregulated chemicals requiring monitoring.

## 2021 City of La Habra Distribution System Water Quality

Disinfection Byproducts	MCL (MRDL/MRDLG)	Average Amount	Range of Detections	MCL Violation?	Typical Source of Contaminant
Total Trihalomethanes (ppb)	80	55	1.1 – 51	No	Byproducts of Chlorine Disinfection
Haloacetic Acids (ppb)	60	10	1 – 15	No	Byproducts of Chlorine Disinfection
Chlorine Residual (ppm)	(4 / 4)	1.12	0.1 – 2.1	No	Disinfectant Added for Treatment
Aesthetic Quality					
Color (color units)	15*	3.1	ND – 7.5	No	Erosion of Natural Deposits
Odor (threshold odor number)	3*	1	1 – 2	No	Erosion of Natural Deposits
Turbidity (NTU)	5*	<0.1	ND – 0.98	No	Erosion of Natural Deposits

Eight locations in the distribution system are tested quarterly for total trihalomethanes and haloacetic acids, and 46 monthly for color, odor and turbidity.

**MRDL** = Maximum Residual Disinfectant Level; **MRDLG** = Maximum Residual Disinfectant Level Goal

\*Contaminant is regulated by a secondary standard to maintain aesthetic qualities.

## Lead and Copper Action Levels at Residential Taps

	Action Level (AL)	Public Health Goal	90 <sup>th</sup> Percentile Value	Sites Exceeding AL / Number of Sites	AL Violation?	Typical Source of Contaminant
Lead (ppb)	15	0.2	ND	0 / 30	No	Corrosion of Household Plumbing
Copper (ppm)	1.3	0.3	0.24	0 / 30	No	Corrosion of Household Plumbing

Every three years 30 residences are tested for lead and copper at-the-tap. The most recent set of samples was collected in 2021.

Lead was not detected in any home. Copper was detected in 26 homes; none exceeded the copper AL.

A regulatory action level is the concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

In 2021, no schools submitted a request to be sampled for lead.

## Unregulated Chemicals Requiring Monitoring in the Distribution System

Chemical	Notification Level	PHG	Average Amount	Range of Detections	Most Recent Sampling Date
Haloacetic acids (HAA5) (ppb)	n/a	n/a	5.8	1.5 – 16	2019
Haloacetic acids (HAA6Br) (ppb)	n/a	n/a	13	0.99 – 31	2019
Haloacetic acids (HAA9) (ppb)	n/a	n/a	14	2.2 – 33	2019

## Source Water Assessments

### Imported (MWDSC) Water Assessment

Every five years, MWDSC is required by DDW to examine possible sources of drinking water contamination in its State Water Project and Colorado River source waters.

The most recent surveys for MWDSC's source waters are the Colorado River Watershed Sanitary Survey – 2020 Update, and the State Water Project Watershed Sanitary Survey – 2016 Update.

Water from the Colorado River is considered to be most vulnerable to contamination from recreation, urban/stormwater runoff, increasing urbanization in the watershed, and wastewater. Water supplies from Northern California's State Water Project are most vulnerable to contamination from urban/stormwater runoff, wildlife, agriculture, recreation, and wastewater.

USEPA also requires MWDSC to complete one Source Water Assessment (SWA) that utilizes information collected in the watershed sanitary surveys. MWDSC completed its SWA in December 2002. The SWA is used to evaluate the vulnerability of water sources to contamination and helps determine whether more protective measures are needed.

A copy of the most recent summary of either Watershed Sanitary Survey or the SWA can be obtained by calling MWDSC at (800) CALL-MWD (225-5693).

### Groundwater Assessment

An assessment of the drinking water sources for the City was completed in December 2010 by City Staff. The sources are considered most vulnerable to the following activities associated with contaminants not detected in the water supply: body shops, gas stations, machine shops, metal plating/finishing/fabricating, repair shops, and sewer collection systems.

A copy of the complete assessment is available at State Water Resources Control Board, Division of Drinking Water, 2 MacArthur Place, Suite 150, Santa Ana, CA 92707. You may request a summary of the assessment by contacting the City at (562) 383-4170.

An assessment of the drinking water sources for Cal Domestic was completed in October 2010. The sources are considered most vulnerable to the following activities associated with contaminants detected in the water supply: drinking water treatment plants; known contaminant plumes; underground storage tanks – confirmed leaking tanks; housing – high density; wells – water supply; and schools. The sources are considered most vulnerable to the following activities not associated with any detected contaminants: transportation corridors – freeways/state highways; and transportation corridors – railroads. A copy of the complete assessment may be viewed at: Cal Domestic, 15505 Whittier Blvd., Whittier, California 90603. You may request a summary of the assessment be sent to you by contacting: Ernesto Che Venegas, Operations Manager at (562) 947-3811.

# Your 2022 Water Quality Report

*The Knowledge You Need for Continued Consumer Confidence*

Look inside to see how our water quality is equal to or better than what is required to safeguard public health.



## City of La Habra

Water Division  
110 E. La Habra Boulevard  
La Habra, California 90633-0337

PRESORT STD  
U.S. Postage  
**PAID**  
Santa Ana, CA  
Permit No. 1208

ECRWSS

**POSTAL CUSTOMER**



## You Can Have Confidence in the Quality of Your Water

The City of La Habra Water Division is pleased to distribute this report to its water customers. It provides important information about where your water comes from and the work we perform each day to assure the water delivered to your tap meets all Federal and State drinking water standards.

The tap water that comes out of your faucet has to meet rigorous State and Federal regulatory standards; otherwise, we wouldn't be able to deliver it to your home.

Our annual water quality report shares details about the water you receive. You can see for yourself that we are meeting and even exceeding standards required to maintain water quality.

Take a look inside for details on water sources, the constituents found in the water, and how

our water compares with State and Federal standards.

The City of La Habra Water Division is committed to safeguarding its water supply and ensuring that your tap water is safe to drink. We also strive to keep you informed about the quality of your water supply.

*We Invite You  
to Learn More  
About Your  
Water's Quality*

For information about this report, or your water quality in general, please contact Brian Jones, Water and Sewer Manager, at (562) 383-4170.

The La Habra City Council meets on the first and third Mondays of each month at 6:30 p.m. in the Council Chambers at 110 East La Habra Boulevard. Public attendance and participation is encouraged and welcomed.

For more information about the health effects of the listed constituents in the enclosed tables, call the USEPA hotline at (800) 426-4791.

# Where Does Our Water Come From?



*...and How Does It Get to Us?*


Have you ever wondered where your water comes from? Here in the City of La Habra our water is drawn from local groundwater supplies then blended with water imported from both Northern California and the Colorado River.

Water from Northern California travels to us through a complex delivery system known as the California State Water Project. Designed and built in the 1960s, the State Water Project is one of the largest public water and power utilities in the world, providing drinking water for more than 25 million people statewide.

Managed by the California Department of Water Resources, the project stretches over 700 miles, from Lake Oroville in the north to Lake Perris in the south. Water stored in Lake Oroville, Folsom Lake, and other tributaries, and fed by snow melt from the Sierra Nevada Mountains, flows into the Sacramento and San Joaquin rivers, and from there into reservoirs in the Bay-Delta region.

From the Bay-Delta, giant pumps lift the water into the 444-mile-long California Aqueduct, there to flow southward to cities and farms in Central and Southern California. Composed mainly of concrete-lined canals, the Aqueduct also includes over 20 miles of tunnels, more than 130 miles of pipelines, and 27 miles of siphons. Along the way, the water is pumped 2,882 feet over the Tehachapi Mountains. The Edmonston Pumping Plant alone lifts millions of gallons a day up 1,926 feet, the highest single water lift in the world.


Is it any wonder the State Water Project is the largest single consumer of power in the State of California?

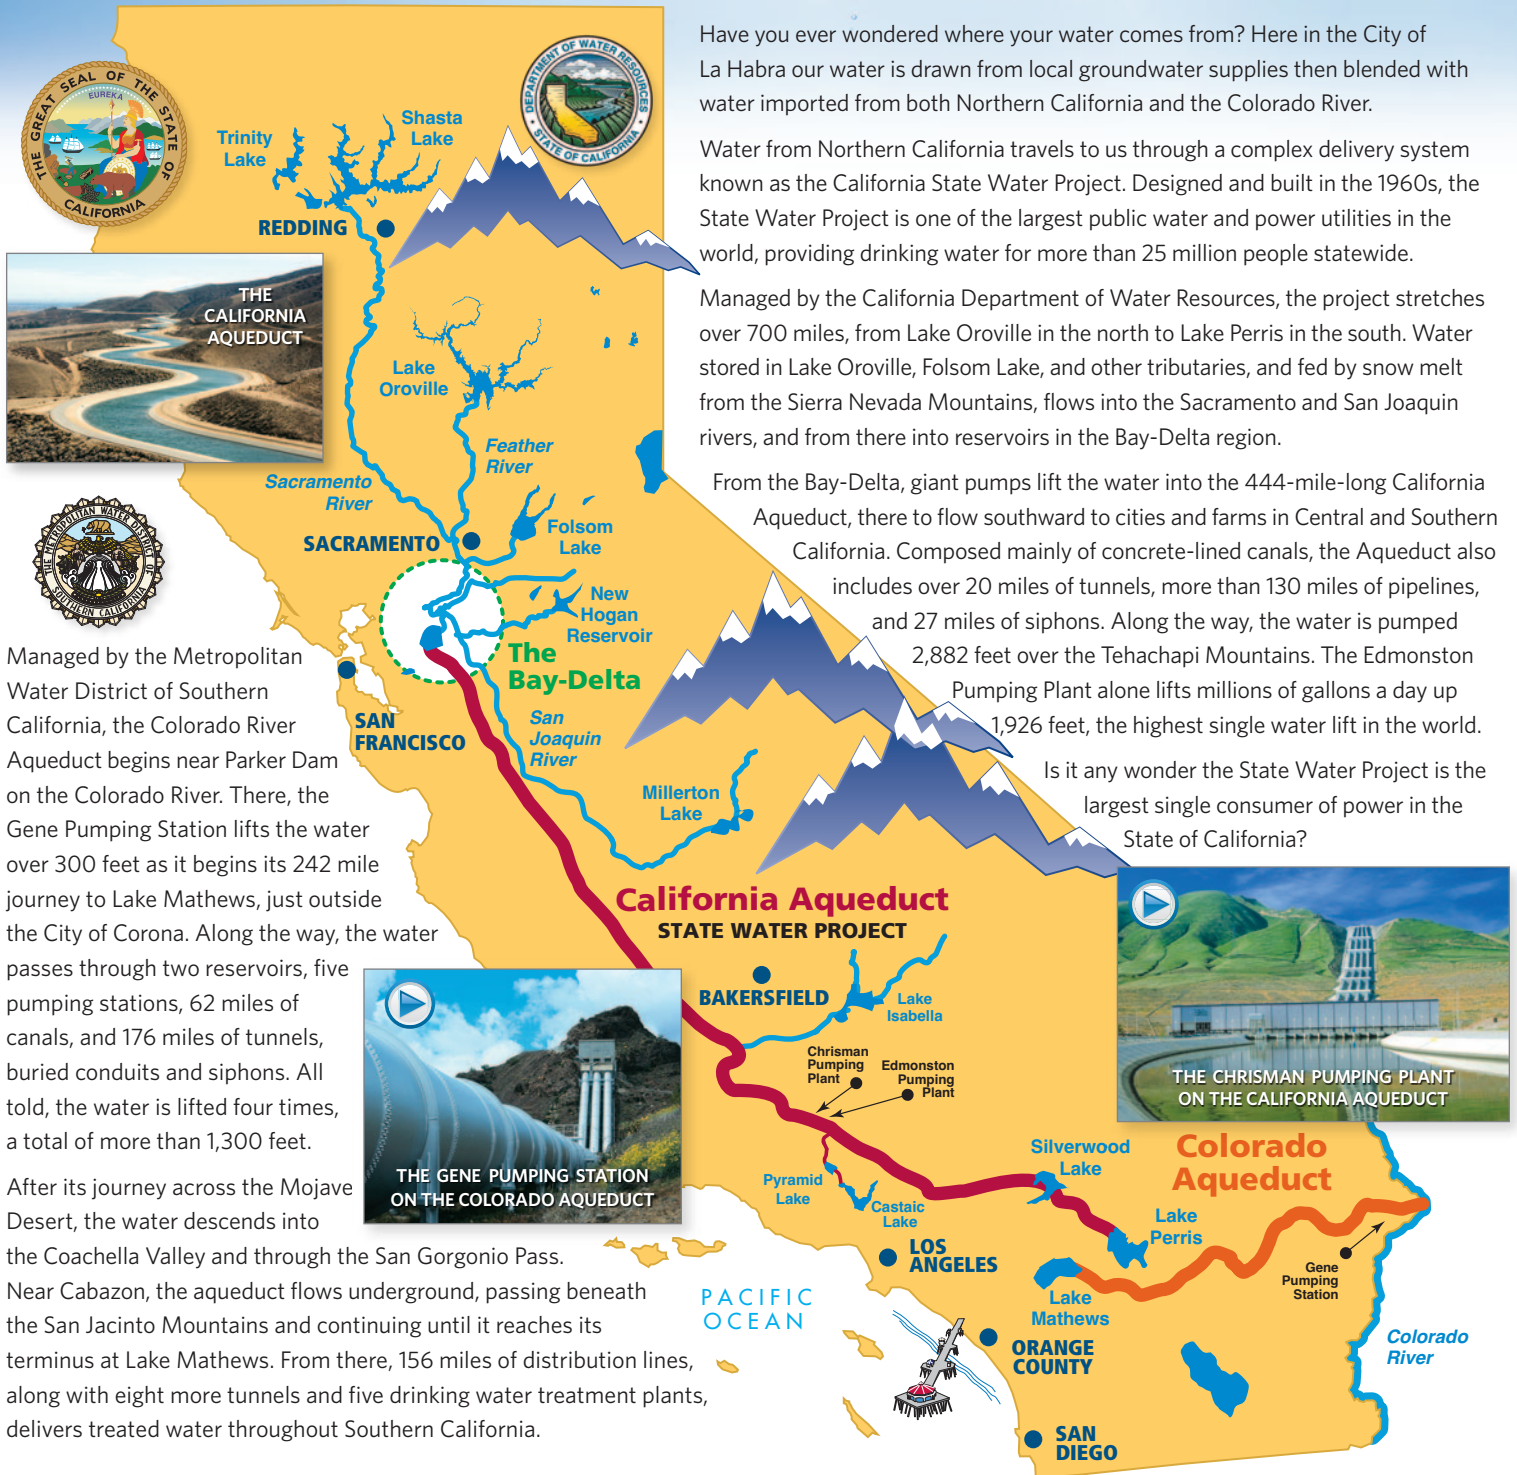

THE CALIFORNIA AQUEDUCT




Managed by the Metropolitan Water District of Southern California, the Colorado River Aqueduct begins near Parker Dam on the Colorado River. There, the Gene Pumping Station lifts the water over 300 feet as it begins its 242 mile journey to Lake Mathews, just outside the City of Corona. Along the way, the water passes through two reservoirs, five pumping stations, 62 miles of canals, and 176 miles of tunnels, buried conduits and siphons. All told, the water is lifted four times, a total of more than 1,300 feet.

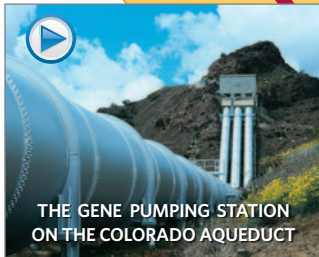


THE GENE PUMPING STATION ON THE COLORADO AQUEDUCT

After its journey across the Mojave Desert, the water descends into the Coachella Valley and through the San Geronio Pass. Near Cabazon, the aqueduct flows underground, passing beneath the San Jacinto Mountains and continuing until it reaches its terminus at Lake Mathews. From there, 156 miles of distribution lines, along with eight more tunnels and five drinking water treatment plants, delivers treated water throughout Southern California.

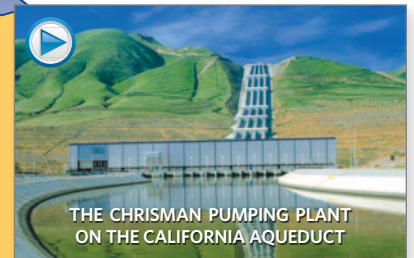

THE CHRISMAN PUMPING PLANT ON THE CALIFORNIA AQUEDUCT

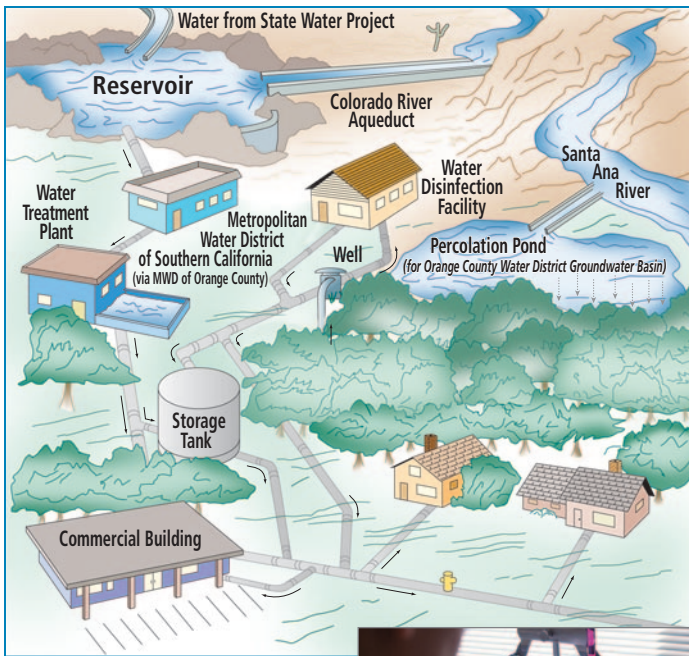


The City of Huntington Beach Utilities Division vigorously works to ensure the safety of your drinking water and, in conjunction with MWDSC and OCWD, continuously monitors the water to verify adherence with drinking water regulations.







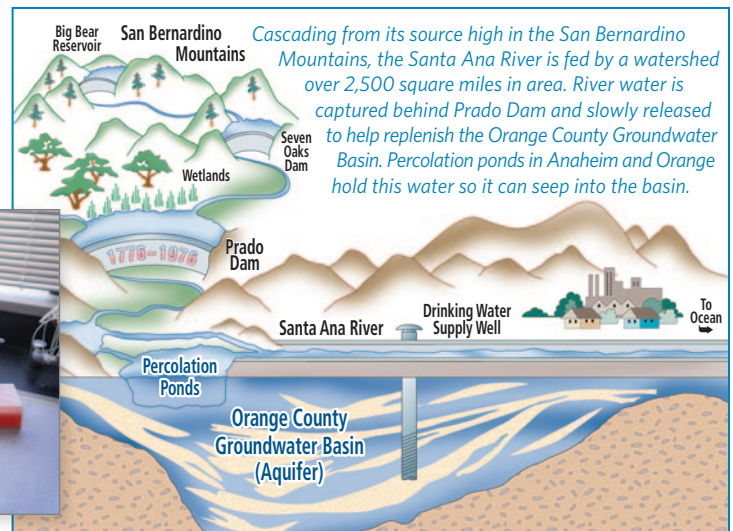

## How Does Our Water Get to Us?

Importing water from hundreds of miles away is only the start to providing you clean, fresh water. Once the water is in the southland, the Metropolitan Water District of Southern California, in partnership with the Municipal Water District of Orange County, treats and pumps the water to individual cities throughout Orange County. The Orange County Water District, which manages the groundwater basin beneath Central and Northern Orange County, ensures the quality and supply of groundwater throughout its service area. The City of Huntington Beach sits atop the county aquifer and draws water from this local source, then blends it with the imported surface water.



## The Need to Conserve Water Remains A High Priority Throughout California


Southern California has an arid climate and wise water use needs to become a part of everyone's daily lives. For as finite as our water resources are, they get smaller every year. Simple water saving acts like the ones listed here can save countless gallons of water every day.

-  Soak pots and pans instead of letting water run while you scrub them clean. ***This both saves water and makes the job easier.***
-  Keep a pitcher of drinking water in the refrigerator. ***This can save gallons of water every day and it's always cold!***
-  Plug the sink instead of running water to rinse your razor or wet your toothbrush. ***This can save upwards of 300 gallons of water a month.***
-  Use a broom instead of a hose to clean off sidewalks and driveways. ***It takes very little time to sweep and the water savings quickly adds up.***
-  Check your sprinkler system for leaks, overspray, and broken sprinkler heads and repair promptly. ***This can save countless gallons each time you water.***
-  Water plants in the early morning. ***It reduces evaporation and ensures deeper watering.***

## Where Do We Use Water the Most?

Outdoor watering of lawns and gardens makes up approximately 60% of home water use. By reducing your outdoor water use — by either cutting back on irrigation or planting more drought tolerant landscaping — you can dramatically reduce your overall water use.

Save the most where you use the most: Make your outdoor use efficient.

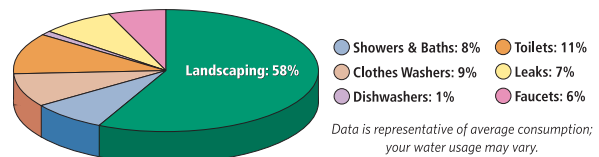

## Where Can You Learn More?

There's a wealth of information on the internet about Drinking Water Quality and water issues in general. Some good sites to begin your own research are:

- Metropolitan Water District of So. California:** [www.mwdh2o.com](http://www.mwdh2o.com)
- California Department of Water Resources:** [www.water.ca.gov](http://www.water.ca.gov)
- The Water Education Foundation:** [www.watereducation.org](http://www.watereducation.org)

To learn more about **Water Conservation & Rebate Information:** [www.bewaterwise.com](http://www.bewaterwise.com) • [www.ocwatersmart.com](http://www.ocwatersmart.com)

And to see the Aqueducts in action, checkout these two videos:

- Wings Over the State Water Project:** [youtu.be/8A1v1Rr2neU](https://youtu.be/8A1v1Rr2neU)
- Wings Over the Colorado Aqueduct:** [youtu.be/KipMQh5t0f4](https://youtu.be/KipMQh5t0f4)



## City of La Habra Water Division

110 E. La Habra Boulevard • La Habra, California 90603-0337  
(562) 383-4000 • [www.lahabracity.com](http://www.lahabracity.com)